


TEMPORARY CONSTRUCTION—SERVICE POLE



1. IF DISTANCE FROM POWER POLE TO TEMPORARY POLE EXCEEDS 75', ADDITIONAL BRACING AND/OR GUYING OF TEMPORARY POLE MAY BE REQUIRED.
2. TEMPORARY POLE SHALL BE A MINIMUM OF 4" X 4" X 18' LENGTH PRESSURE TREATED POST. POLE STRUCTURE MUST WITHSTAND 200 lb PULL AT TOP OF POLE. IF THE SERVICE DROP CROSSES A STREET OR DRIVEWAY WHICH IS OPEN TO TRUCK TRAFFIC, THE MIN HEIGHT OF THE TEMP POLE SHALL BE 18' ABOVE GROUND.
3. TEMPORARY POLE TO BE SET AT A MINIMUM DEPTH OF 4' BELOW GRADE.
4. AN OPTIONAL 18" X 6" DIA. PRESSURE TREATED ROUND POLE MAY BE USED IF DESIRED. THIS POLE DOES NOT REQUIRE BRACING.
5. POLE BRACES SHALL CONSIST OF TWO 2" X 4" X 14' LENGTHS OF LUMBER FIRMLY ATTACHED TO A 2" X 4" X 4' STAKE DRIVEN TO A DEPTH OF 18" INTO THE GROUND. PRESSURE TREATED LUMBER IS OPTIONAL FOR BRACES.
6. CALL KEYS ENGINEERING DEPT. AT (305) 295-1042 IF YOU HAVE ANY QUESTIONS.
7. ALL WORK TO CONFORM TO CITY, COUNTY & NEC CODE.

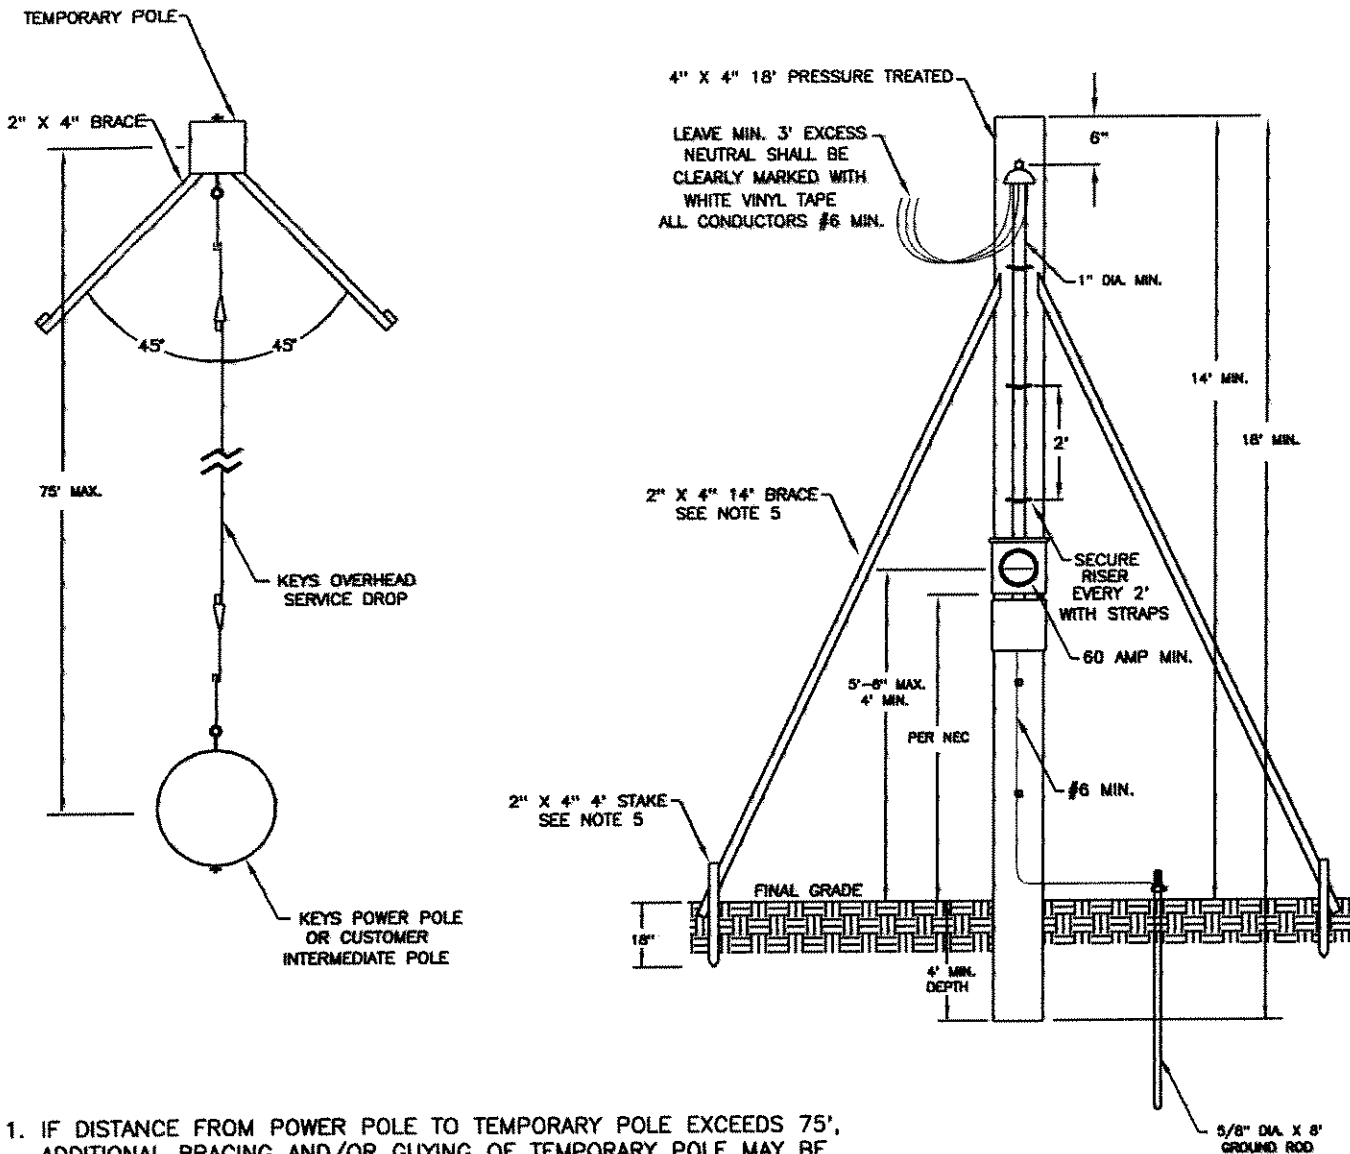

KEYS ENERGY SERVICES ENGINEERING DEPT. KEY WEST FL.	
TEMPORARY CONSTRUCTION SERVICE POLE	
DESIGNED BY: D. FINIGAN	
APPROVED BY:	
DATE: 8-06-01	
DRAWN BY: VIN SMITH	
SCALE: NONE	SHEET 1 OF 1

M-912